


## WALL ASSEMBLIES

**EZ TAPING SYSTEM, INC. - Green Bay, WI USA**

- ▷ DESIGN NO. EZT/WA 60-01
- ▷ DESIGN NO. EZT/WA 60-02
- ▽ DESIGN NO. EZT/WA 120-01

**DESIGN NO. EZT/WA 120-01  
ASSEMBLY RATING - 2 HOURS, NON-BEARING WALL**

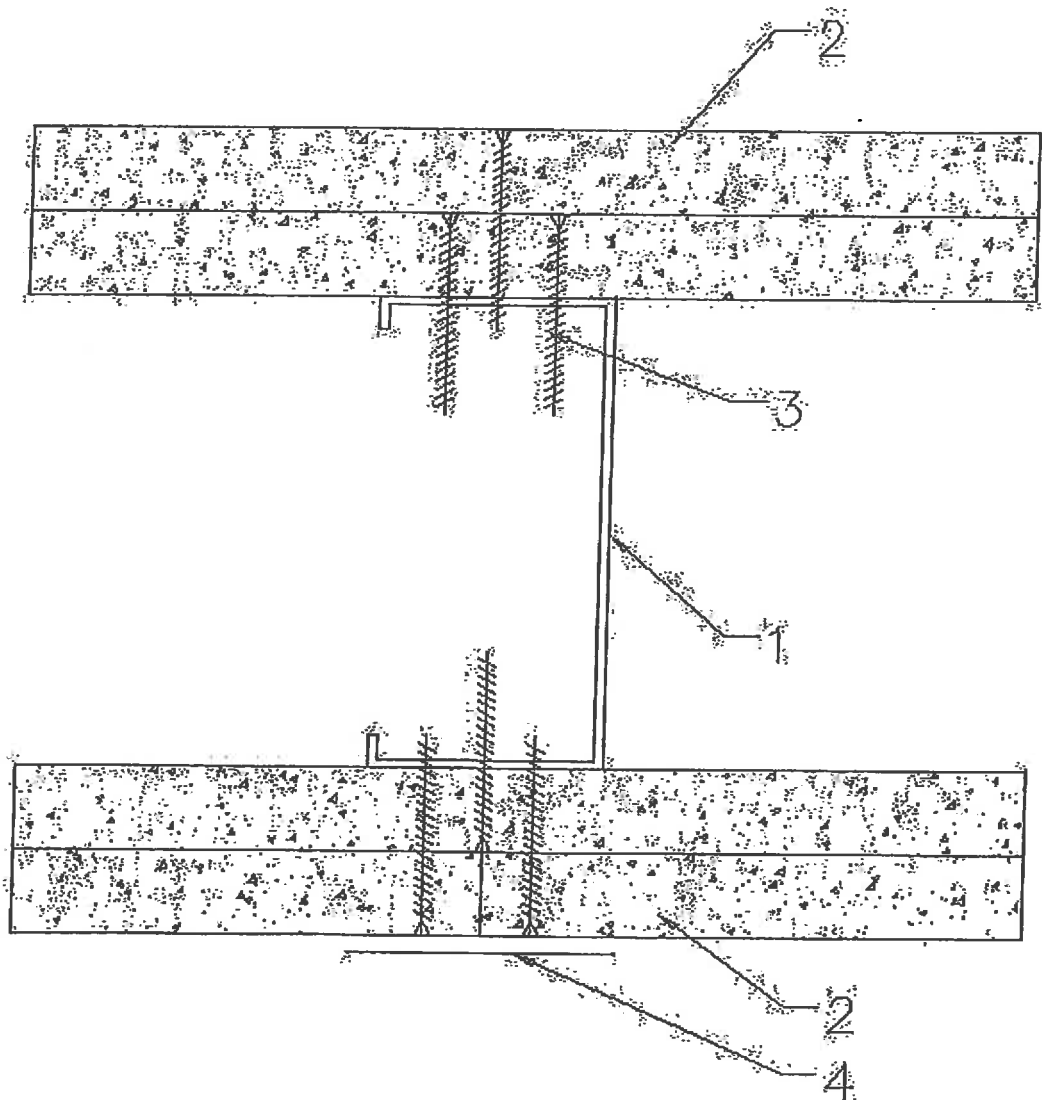

- |    |  |
|----|--|
| 1. | <b>Steel Studs:</b> 'C' Shaped 3-5/8" minimum deep, fabricated from minimum 0.019" thick galvanized steel. Cut to length 1/2" less than the openings height and spaced 24" maximum oc. |
|----|--|

2.	<p><b>Gypsum Board:</b> Two (2) hour rated walls have two (2) layers of 5/8" Type 'X' gypsum wallboard panels on each side of the steel studs. The "Fire Tape" product would be used as an alternative to conventional joint tape in specific systems when:</p> <ol style="list-style-type: none"> <li>1. Two or more layers of listed Type 'X' gypsum wallboard are applied vertically with joints staggered and the joints of the face boards are:               <ol style="list-style-type: none"> <li>a. Tightly butted and taped with EZ Taping Systems "Fire Tape" or</li> <li>b. Finished with joint compound of EZ Taping Systems "Fire Tape" if the gap between gypsum wallboard panels are visible at the joint.</li> </ol> </li> <li>2. Two or more layers of USG "Sheetrock" Firecode C gypsum wallboard are applied (horizontally or vertically).               <ol style="list-style-type: none"> <li>a. The panels shall be tightly butted with the joints staggered and taped with EZ Taping Systems "Fire Tape".</li> <li>b. If a gap is visible at the joint, a finishing coat of joint compound over the EZ Taping Systems "Fire Tape" would be required.</li> </ol> </li> </ol>
3.	<p><b>Attachment:</b> 1-1/8" long, Type S drywall screws, spaced 8" oc to vertical edges and 12" oc to top and bottom runners and intermediate studs.</p>
4.	<p><b>"Fire Tape":</b> Nominal 2" (48mm) wide EZ Taping System, Inc. Fire Tape applied on the vertical joints at studs.</p>

\*Components bearing the Warnock Hersey Certification Mark.

Testing Standards: CAN/ULC-S101, NFPA-251, UL-263.

‣ DESIGN NO. EZT/WA 120-02

‣ Evaluated to the following...

